

Footpaths drawing index



SED_NO	SED_Version	Title	Last Published	Comments
FP0000	C	Footpaths & pedestrian facilities drawing index	27/07/2024	Drawing Added
FP0001	C	Concrete footpath	27/07/2024	No change
FP0002	B	Longitudinal joints and stitching bar details	27/07/2024	No change
FP0003	B	Asphalt footpath	27/07/2024	No change
FP0004	B	Footpath construction - paver type	27/07/2024	No change
FP0005	C	Footpath edging detail	27/07/2024	Title change
FP0006	D	Pram crossing	27/07/2024	minor change
FP0009	A	Metal and Hoggin footpath	27/07/2024	No change
FP0010	A	Tactile Pavers	27/07/2024	No change
FP0011	C	Zebra Crossing	27/07/2024	Title change new drawing
FP0012	A	Zebra Crossing - Centre Island/pedestrian refuge	-	new drawing
FP0013	A	Zebra Crossing - Side Island/kerb buildouts	-	new drawing
FP0014	A	Pedestrian & cyclist access way alternative sections	-	previously FP0011



TDM TECHNICAL STANDARDS
Footpaths & pedestrian facilities drawing index

Date: 05/03/2026

SED No.	Version
FP0000	C

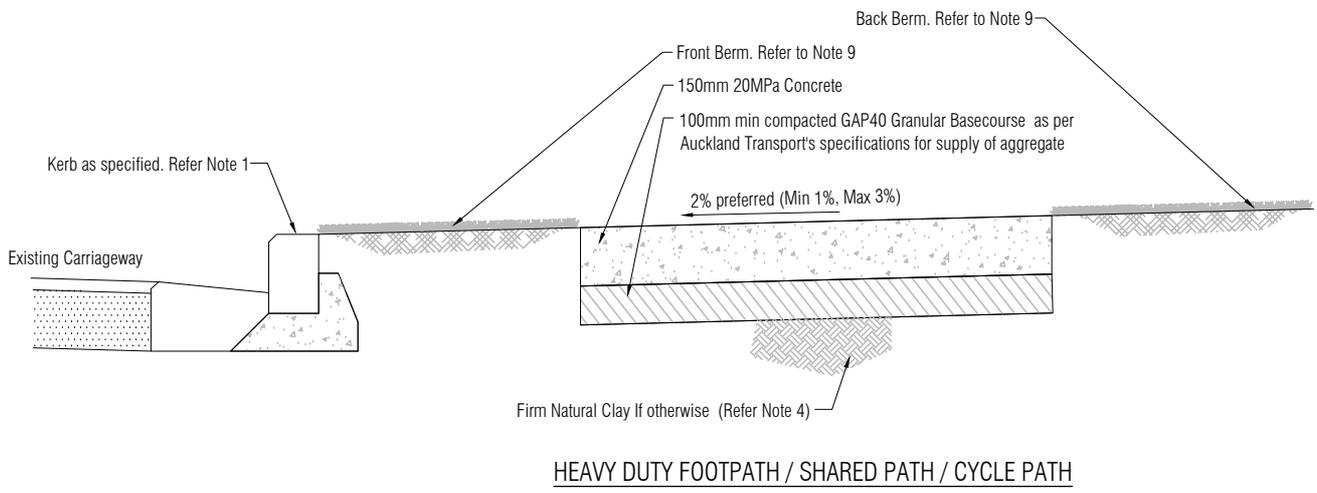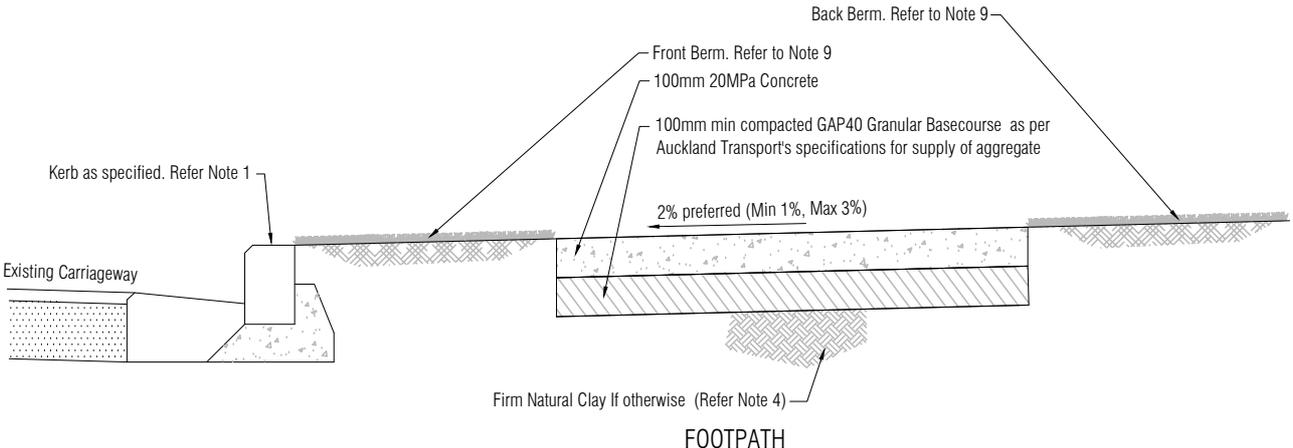


NOTES

1. Kerb profiles can be found in the kerb & Channel drawing set. Refer to Urban and Rural Roadway Engineering Design Code for further details.
2. All Services Lids must be raised or lowered to be flush with footpath levels.
3. Concrete to have minimum compressive strength of 20MPa at 28th day strength.
4. Basecourse or bedding layer depth must be increased for weak subgrade (CBR<3).
5. Concrete surface finish must comply with NZS 3114.
6. If footpath to be trafficked by service vehicles 664 mesh or fibre reinforcement must be used.
7. Surface to be broom finished unless exposed selected.
8. Crack joining to be installed at 3m intervals.
9. Check with EDC Footpath and Public Realm, table 1 for Urban Footpath and table 2 for Rural Footpath
10. Standard concrete path is 20MPa. If heavy vehicle need to use part of concrete cycle path, a 30 MPa concrete can be considered through Departure process – 30MPa concrete have higher carbon content.
11. Concrete footpaths to have 4kg/m³ black oxide, Concrete cycle paths to have 8kg/m³ black oxide




TDM TECHNICAL STANDARDS
Concrete footpath

Date:	10/02/2025	
SED No.	Version	
FP0001	C	

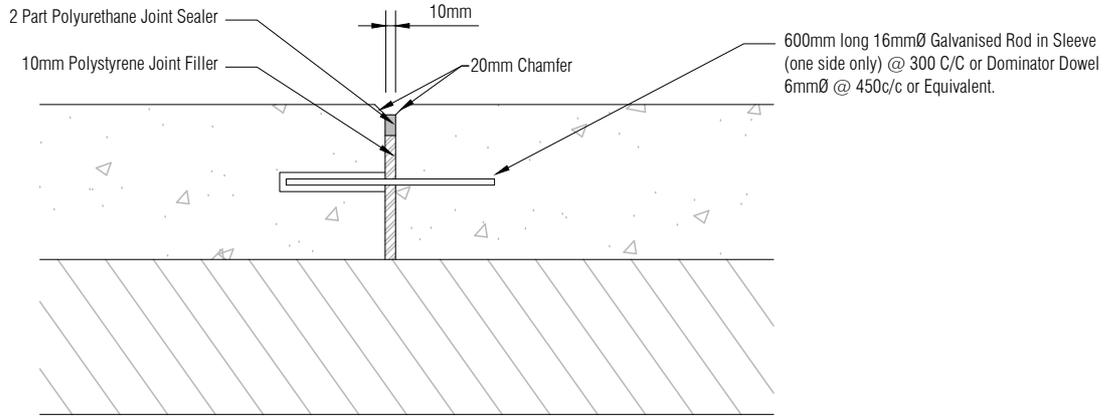

EXPANSION / CONSTRUCTION JOINT CROSS SECTION

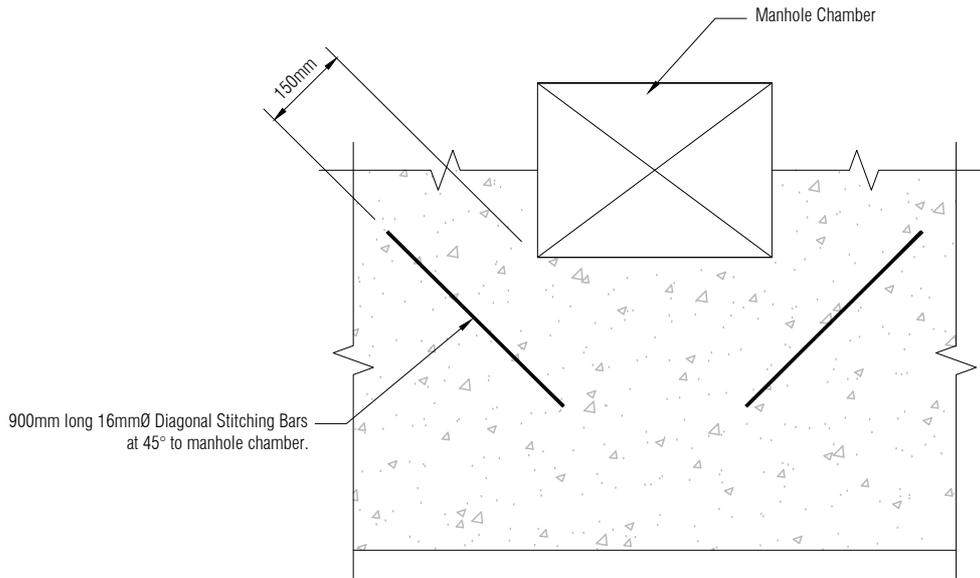


STITCHING BAR PLAN DETAIL


NOTES

1. Refer to Auckland Transport Standard Detail Drawing FP0001 for footpath details
2. All Services Lids must be raised or lowered to be flush with footpath levels.
3. Concrete to have minimum compression of 20MPa at 28th day
4. Concrete surface finish much comply with NZS 3114
5. Expansion / Construction Joint detail to be used when increasing the width of a footpath. Minimum width of new footpath must be two times the length of the dowel.



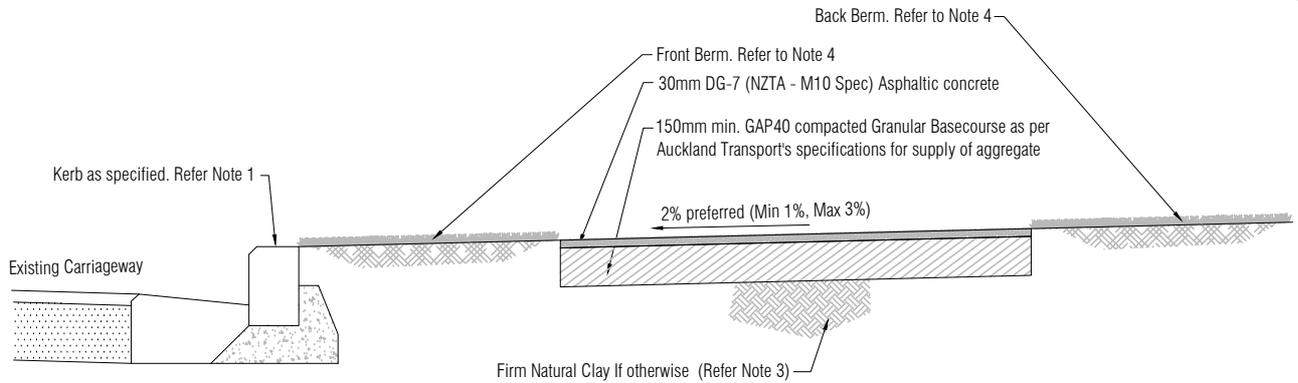

FOOTPATH

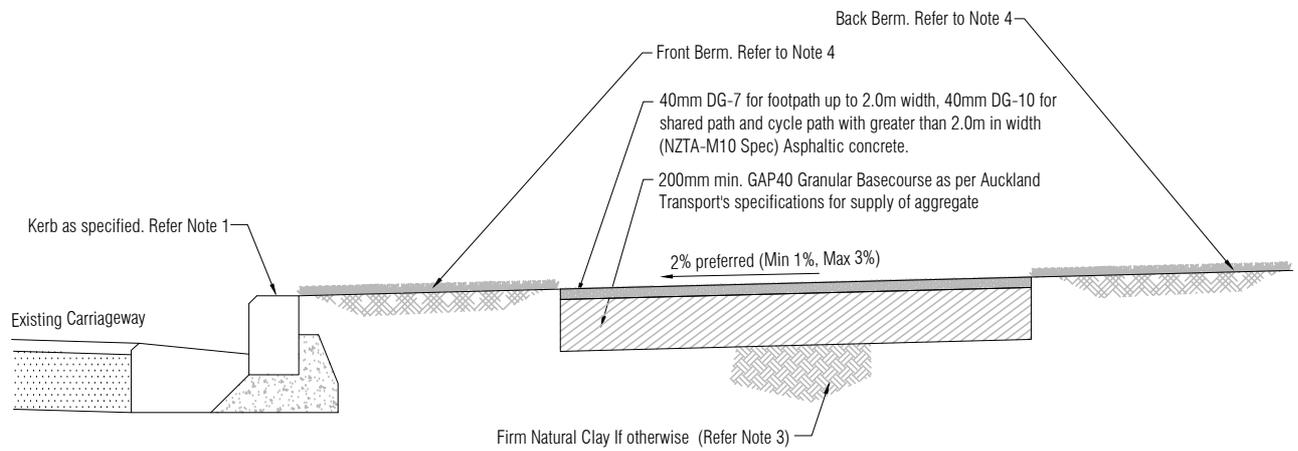

HEAVY DUTY FOOTPATH / SHARED PATH / CYCLE PATH

NOTES

1. All Services Lids must be raised/lowered to be flush with Footpath levels.
2. Footpath crossfall is to be 2% preferred and 3% maximum.
3. Basecourse or Bedding Layer depth must be increased for weak subgrade (CBR<3)
4. Check with EDC Footpath and Public Realm, table 1 for Urban Footpath and table 2 for Rural Footpath



TDM TECHNICAL STANDARDS


Asphalt footpath

Date: 10/02/2025


SED No. Version

FP0003

B

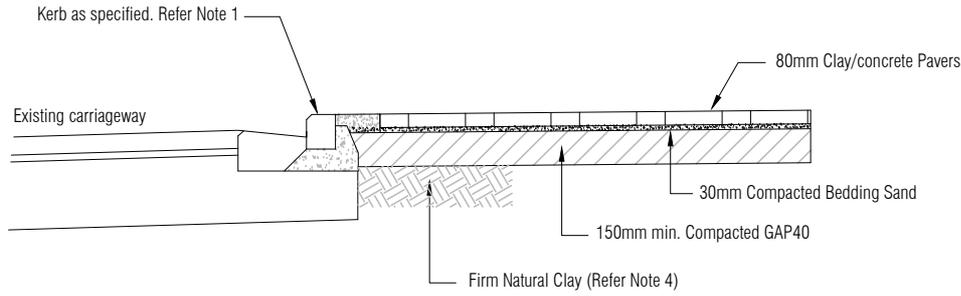

TYPICAL CROSS SECTION

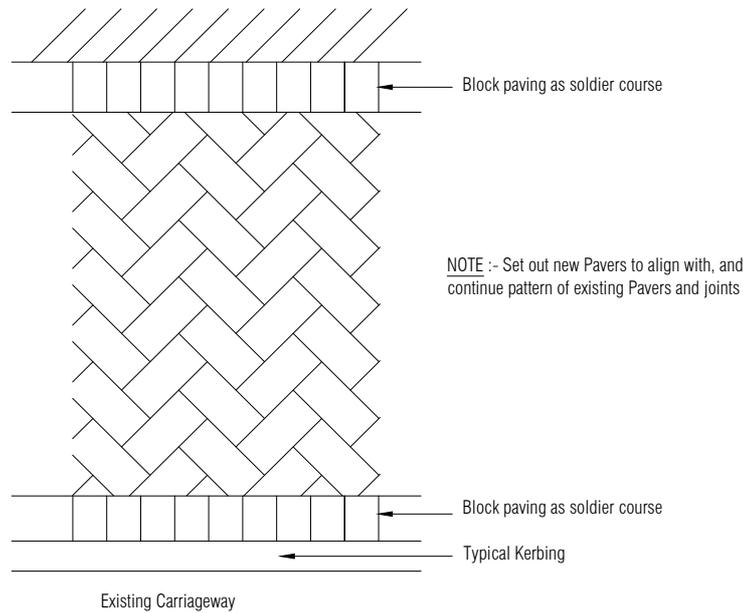

TYPICAL PLAN VIEW

NOTES

1. Refer to Auckland Transport Standard Detail Drawings for the following details :-
 Pram crossings - Plan No. FP0006
 Kerbs and Channels - Section KC0000.
2. All Services Lids must be raised or lowered must be flush with footpath levels.
3. All work in accordance with NZS 3116:2002 - Concrete Segmental and Flagstone paving and Suppliers Instructions.
4. Basecourse Layer depth must be increased for weak subgrade (CBR < 3), as directed by the relevant AT Engineer.
5. Plant based herbicide weed killer must be applied before placement of aggregate .




TDM TECHNICAL STANDARDS

Footpath construction - paver type


Date: 10/02/2025

SED No. Version


FP0004 B

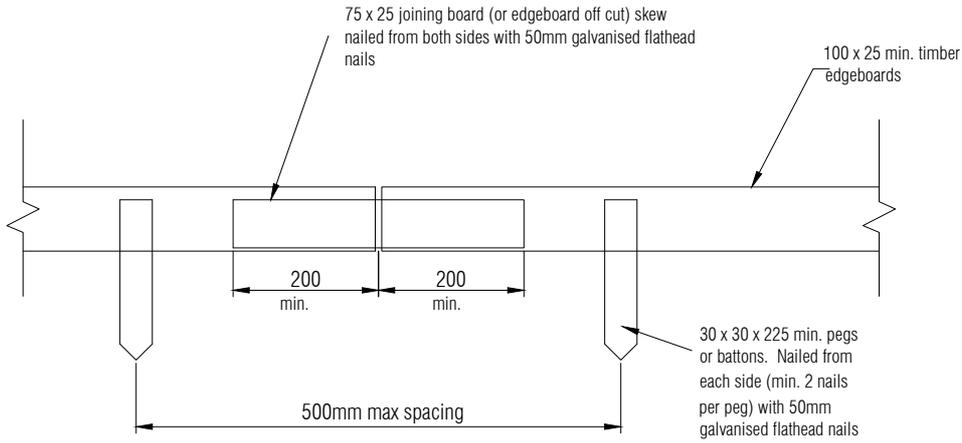

TYPICAL JOINING BOARD DETAIL

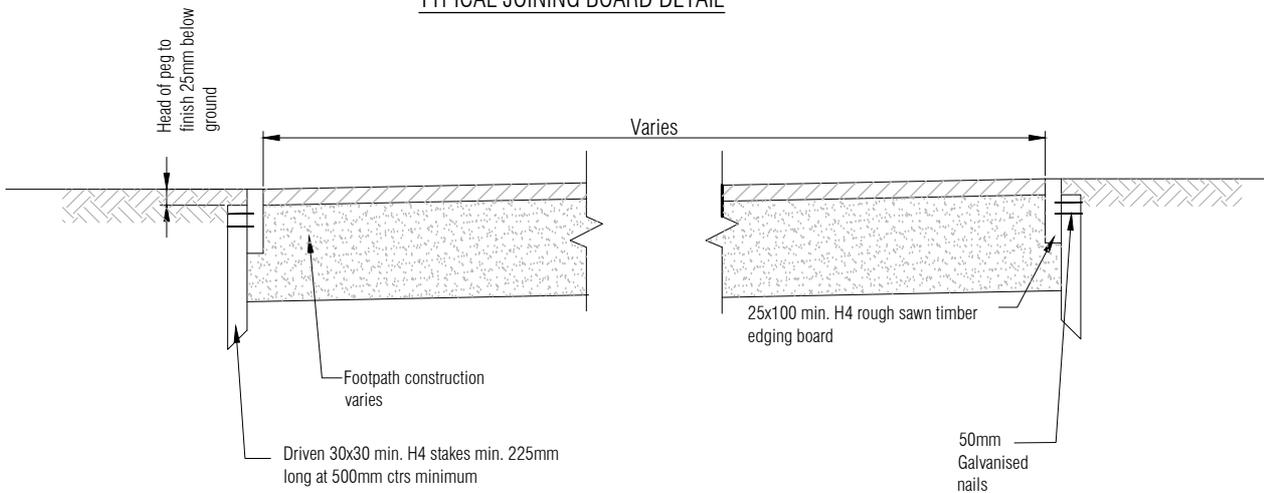

TYPICAL FOOTPATH CROSS SECTION

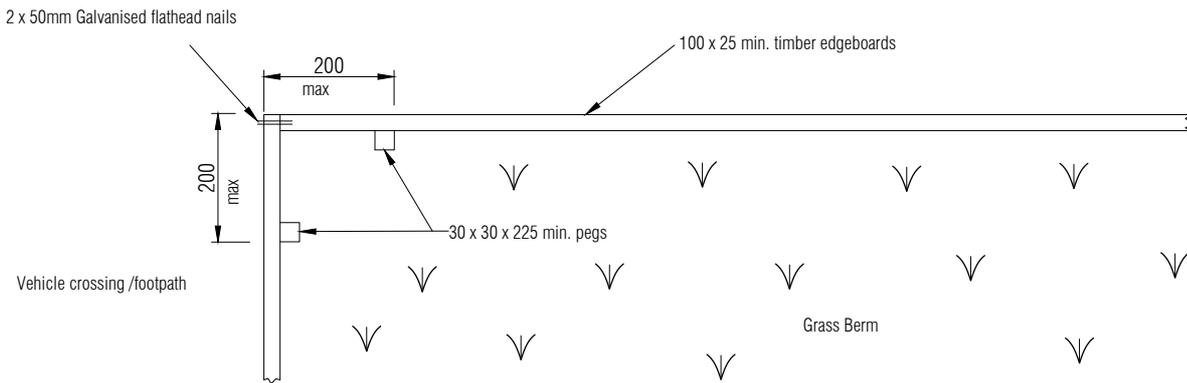

TYPICAL CORNER DETAIL

NOTES:

1. All timber must be H4 treated.
2. The timber thicknesses and depths shown are minimum only and where site conditions require the dimensions are to be increased to suit or as directed by the relevant AT Engineer.



TDM TECHNICAL STANDARDS

Footpath edging detail

Date: 05/03/2026

SED No. Version

FP0005 C




TDM TECHNICAL STANDARDS


Pram crossing

Date: 10/02/2025

SED No. **FP0006** Version **D**

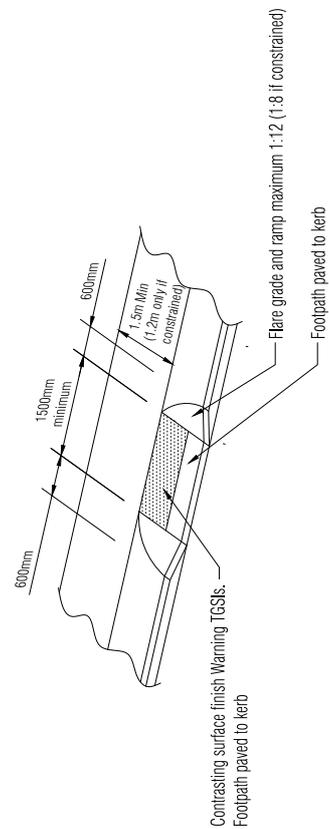


SURFACE FINISH TO KERB RAMPS

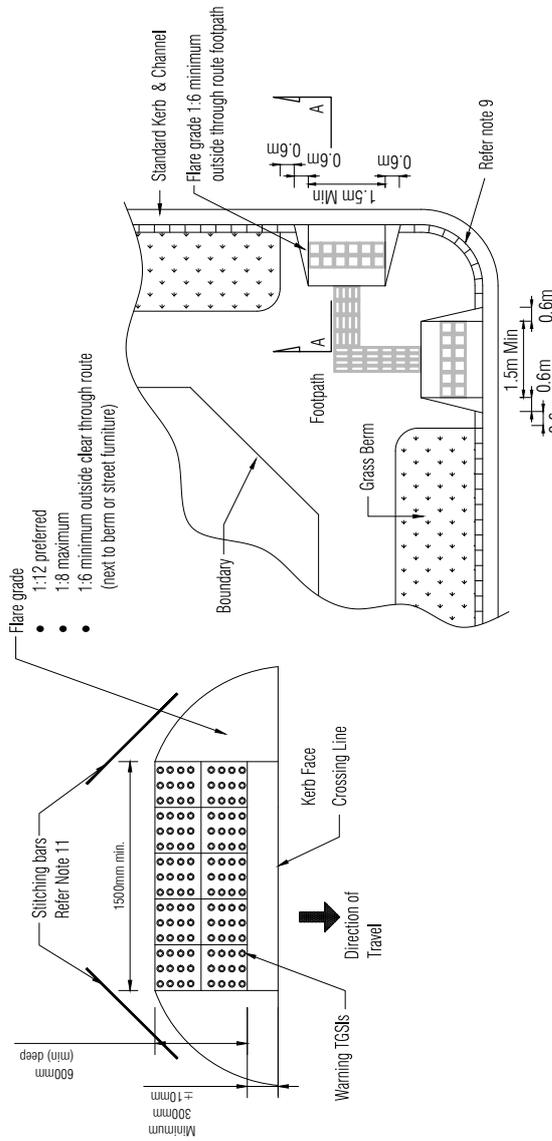


NOTES

- Edge of crossing to be finished flush with existing channel. (No Lip, maintain common surface).
- Tactile Ground Surface Indicator (TGSi) must be installed in accordance with:
 - NZTA RTS 14 Guidelines for facilities for blind and vision-impaired pedestrians.
 - AS/NZS 1428.4:2009 Design for access and mobility.
- 300x300mm sealed yellow concrete warning TGSi tiles are to have a 100mm thick concrete slab under them and be butt jointed.
- The crossing point should be oriented such that the leading edge of the crossing is perpendicular to the direction of travel.
- Directional TGSIs should be provided as appropriate for the footpath configuration (not shown on this drawing).
- Bluestone kerb blocks (where needed) must not extend across a pram crossing.
- Unless otherwise approved by the relevant AT engineer, pram crossing must be constructed in accordance with the requirements for a concrete footpath.
- The pram crossing ramp and flares should be constructed in contrasting colour and / or texture to the adjacent footpath.
- The length of kerb upstand between kerb ramps shall be greater than 1.0m. A corner with no kerb upstand is permitted only where Barnes Dance pedestrian crossing is provided.
- Pram crossing must be constructed in accordance with requirements for concrete footpath.
- Stitching bars to be installed on corners as per TDM Technical standards FP0002A

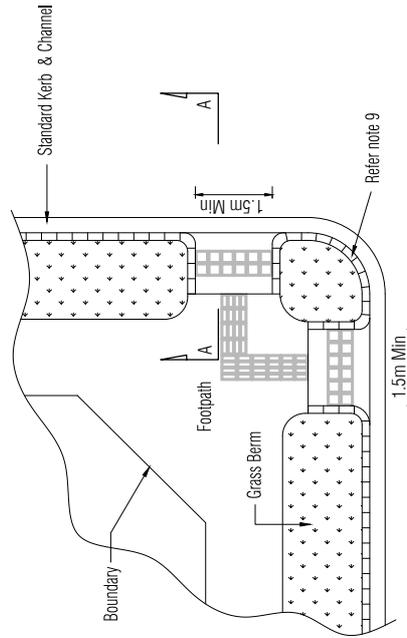


PLAN (OPTION 2)

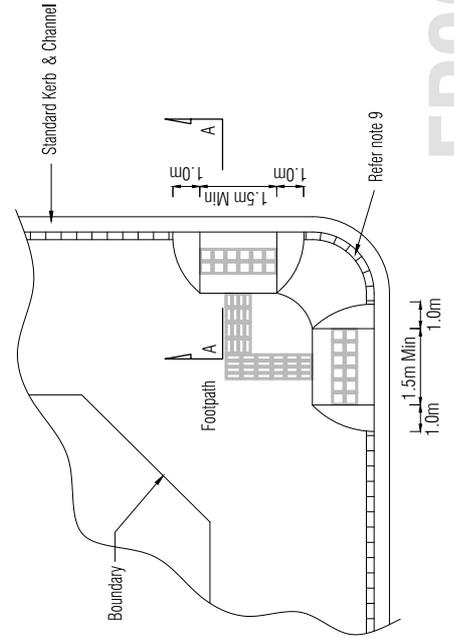


PLAN (OPTION 3)

PLAN (OPTION 1)

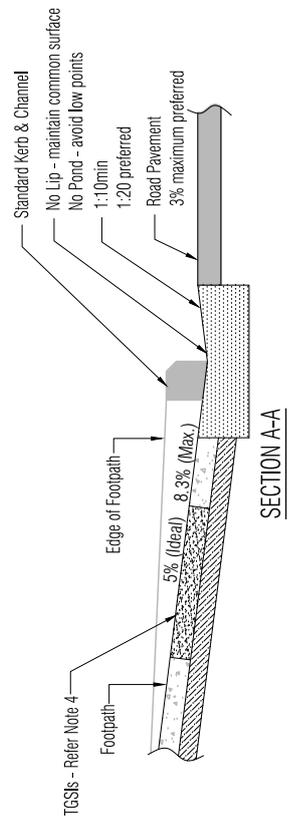

NOTES


1. Weeds are able to grow easily through a hoggin surface, so the subgrade needs to be adequately prepared. Weed control should be achieved through weed spraying of the basecourse before construction and the use of weed mats or other membranes below the basecourse.
2. Weed control to be achieved using plant based herbicides.
3. Hoggin is susceptible to surface water scour. Do not use where gradient exceeds 8%, or where surface water cannot be shed from the surface to adjoining berm
4. Basecourse or Bedding Layer depth must be increased for weak subgrade (CBR <3)

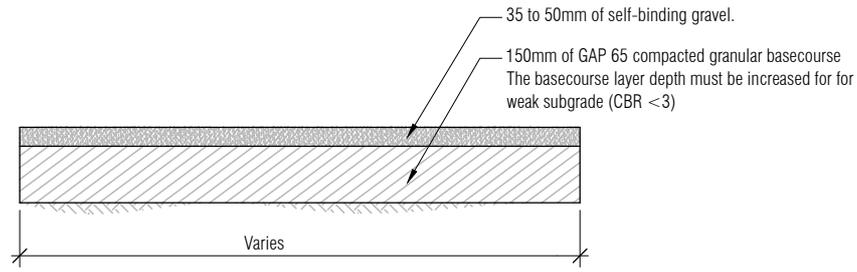

HOGGIN FOOTPATH

NOTES

1. Weeds are able to grow easily through a metal surface, so the subgrade needs to be adequately prepared. Weed control should be achieved through weed spraying of the basecourse before construction and the use of weed mats or other membranes below the basecourse.
2. Weed control to be achieved using plant based herbicides.
3. Basecourse or Bedding Layer depth must be increased for weak subgrade (CBR <3)

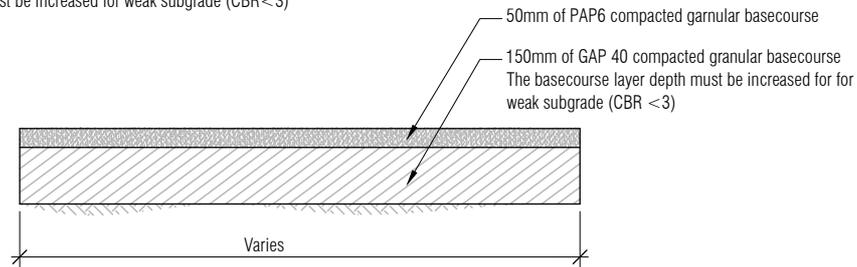

METAL FOOTPATH




TDM TECHNICAL STANDARDS

Metal and Hoggin footpath


Date: 10/02/2025

SED No. Version


FP0009 A

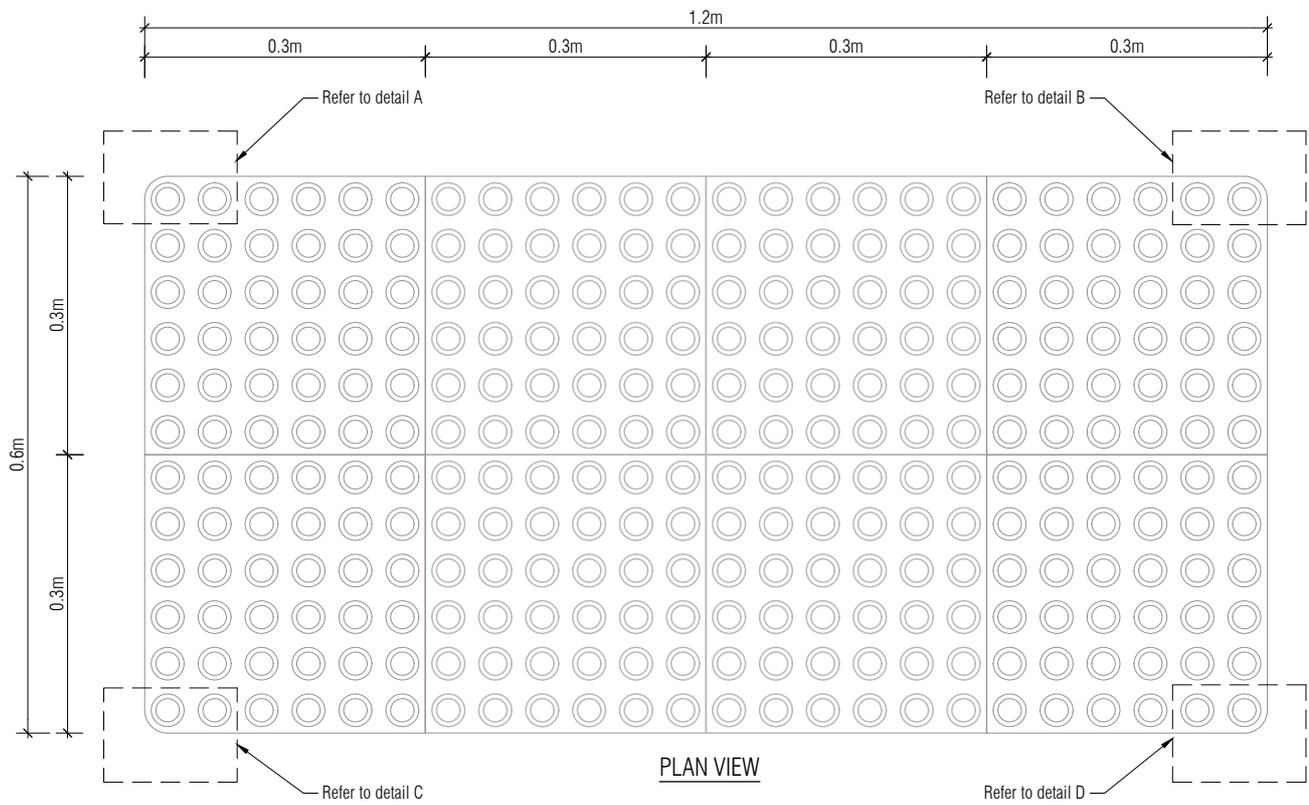


PLAN VIEW

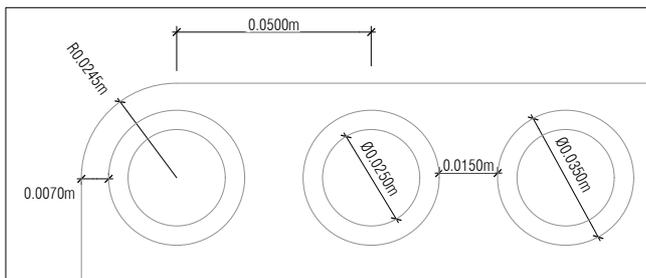


DETAIL A

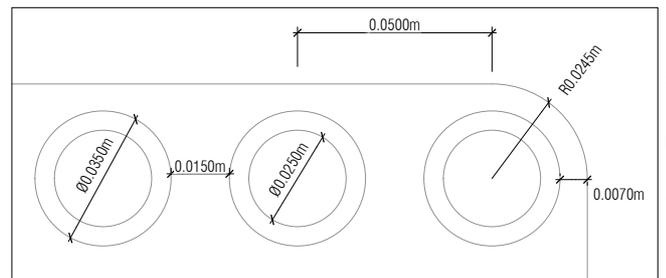

DETAIL B

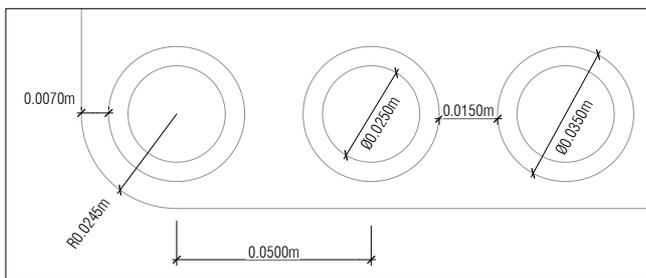

DETAIL C

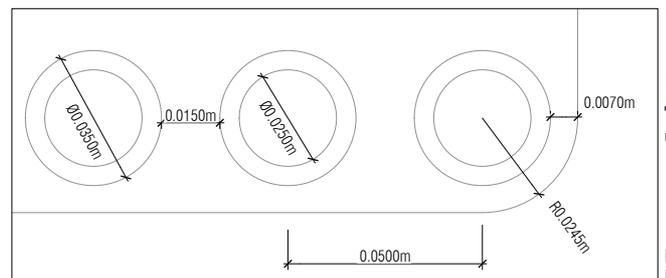

DETAIL D




TDM TECHNICAL STANDARDS

Tactile Pavers

Date: 10/02/2025


SED No. Version

FP0010 A

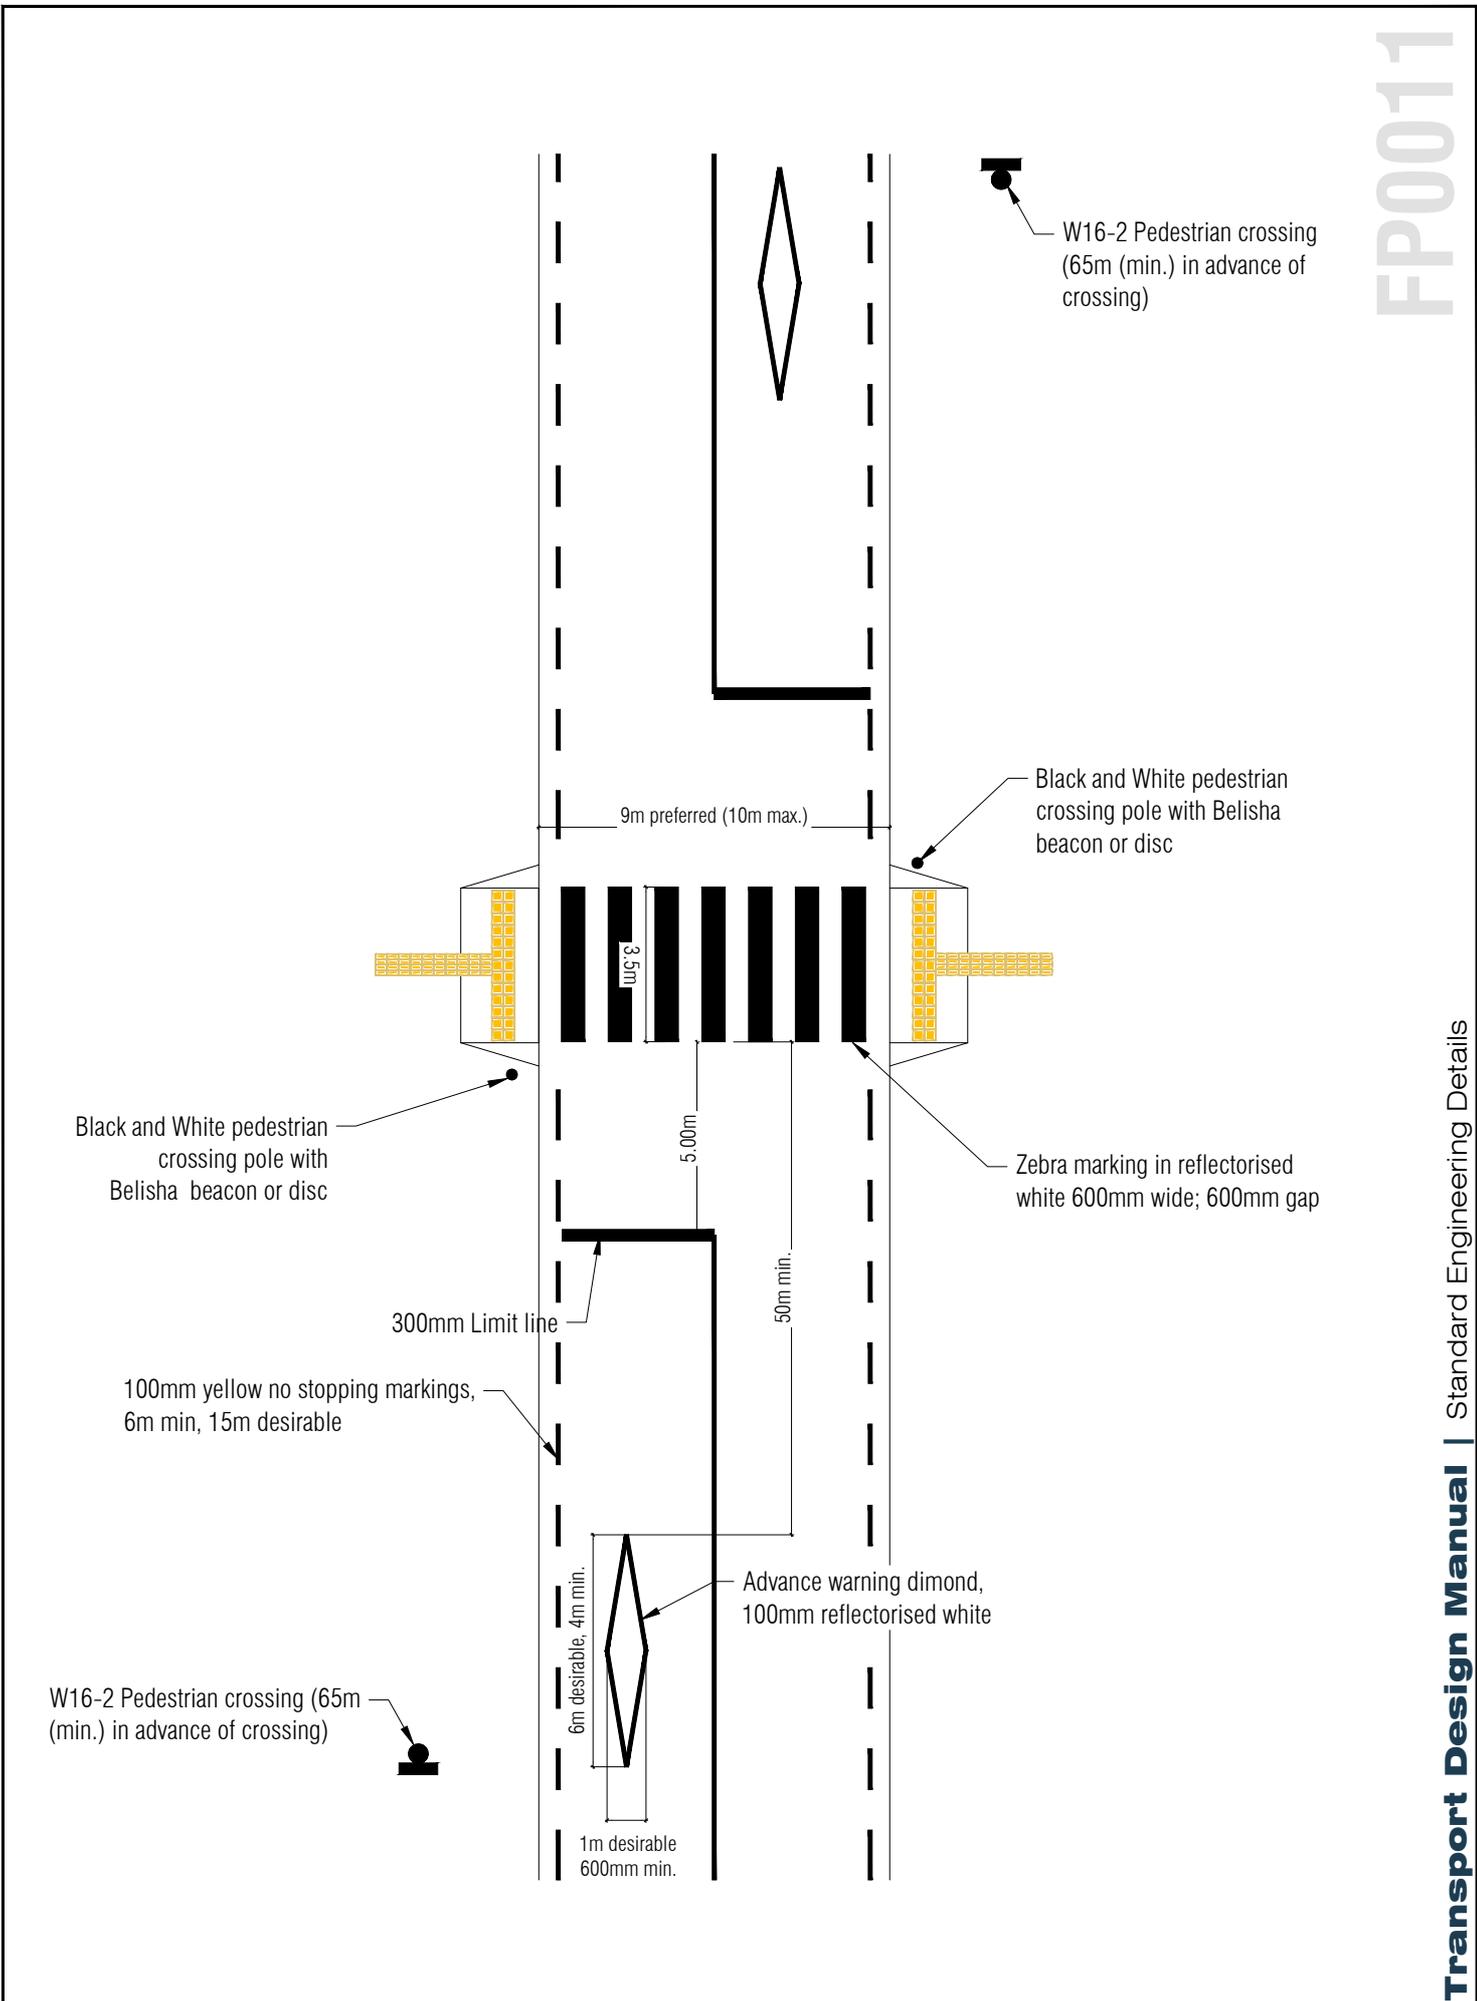


TDM TECHNICAL STANDARDS
Zebra Crossing

Date:	05/03/2026	
SED No.	FP0011	Version
	C	

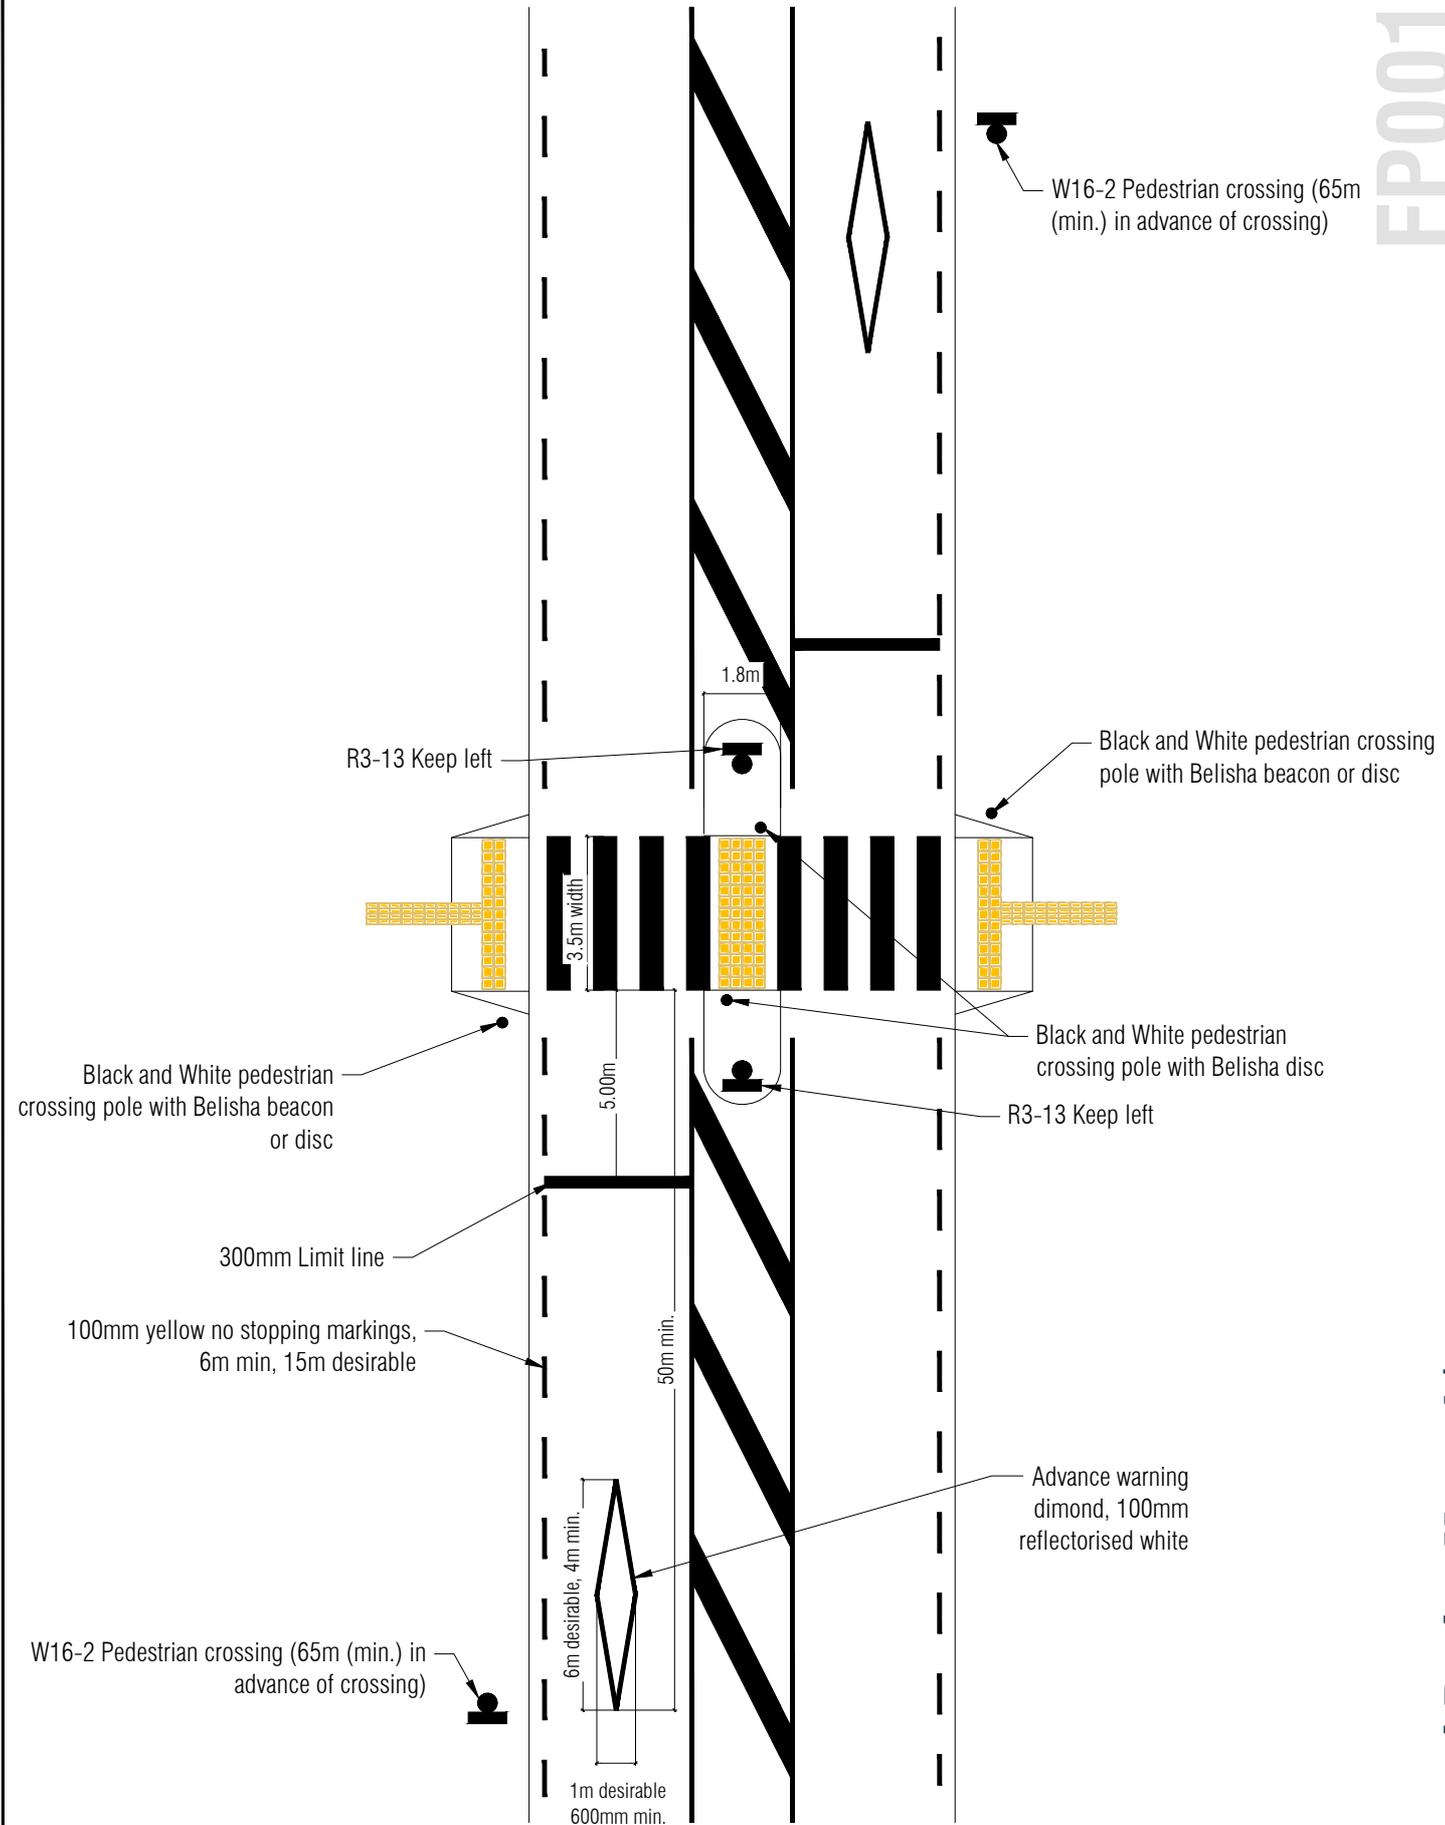


TDM TECHNICAL STANDARDS
Zebra Crossing - Centre Island/pedestrian refuge

Date:	05/03/2026	
SED No.	Version	
FP0012	A	

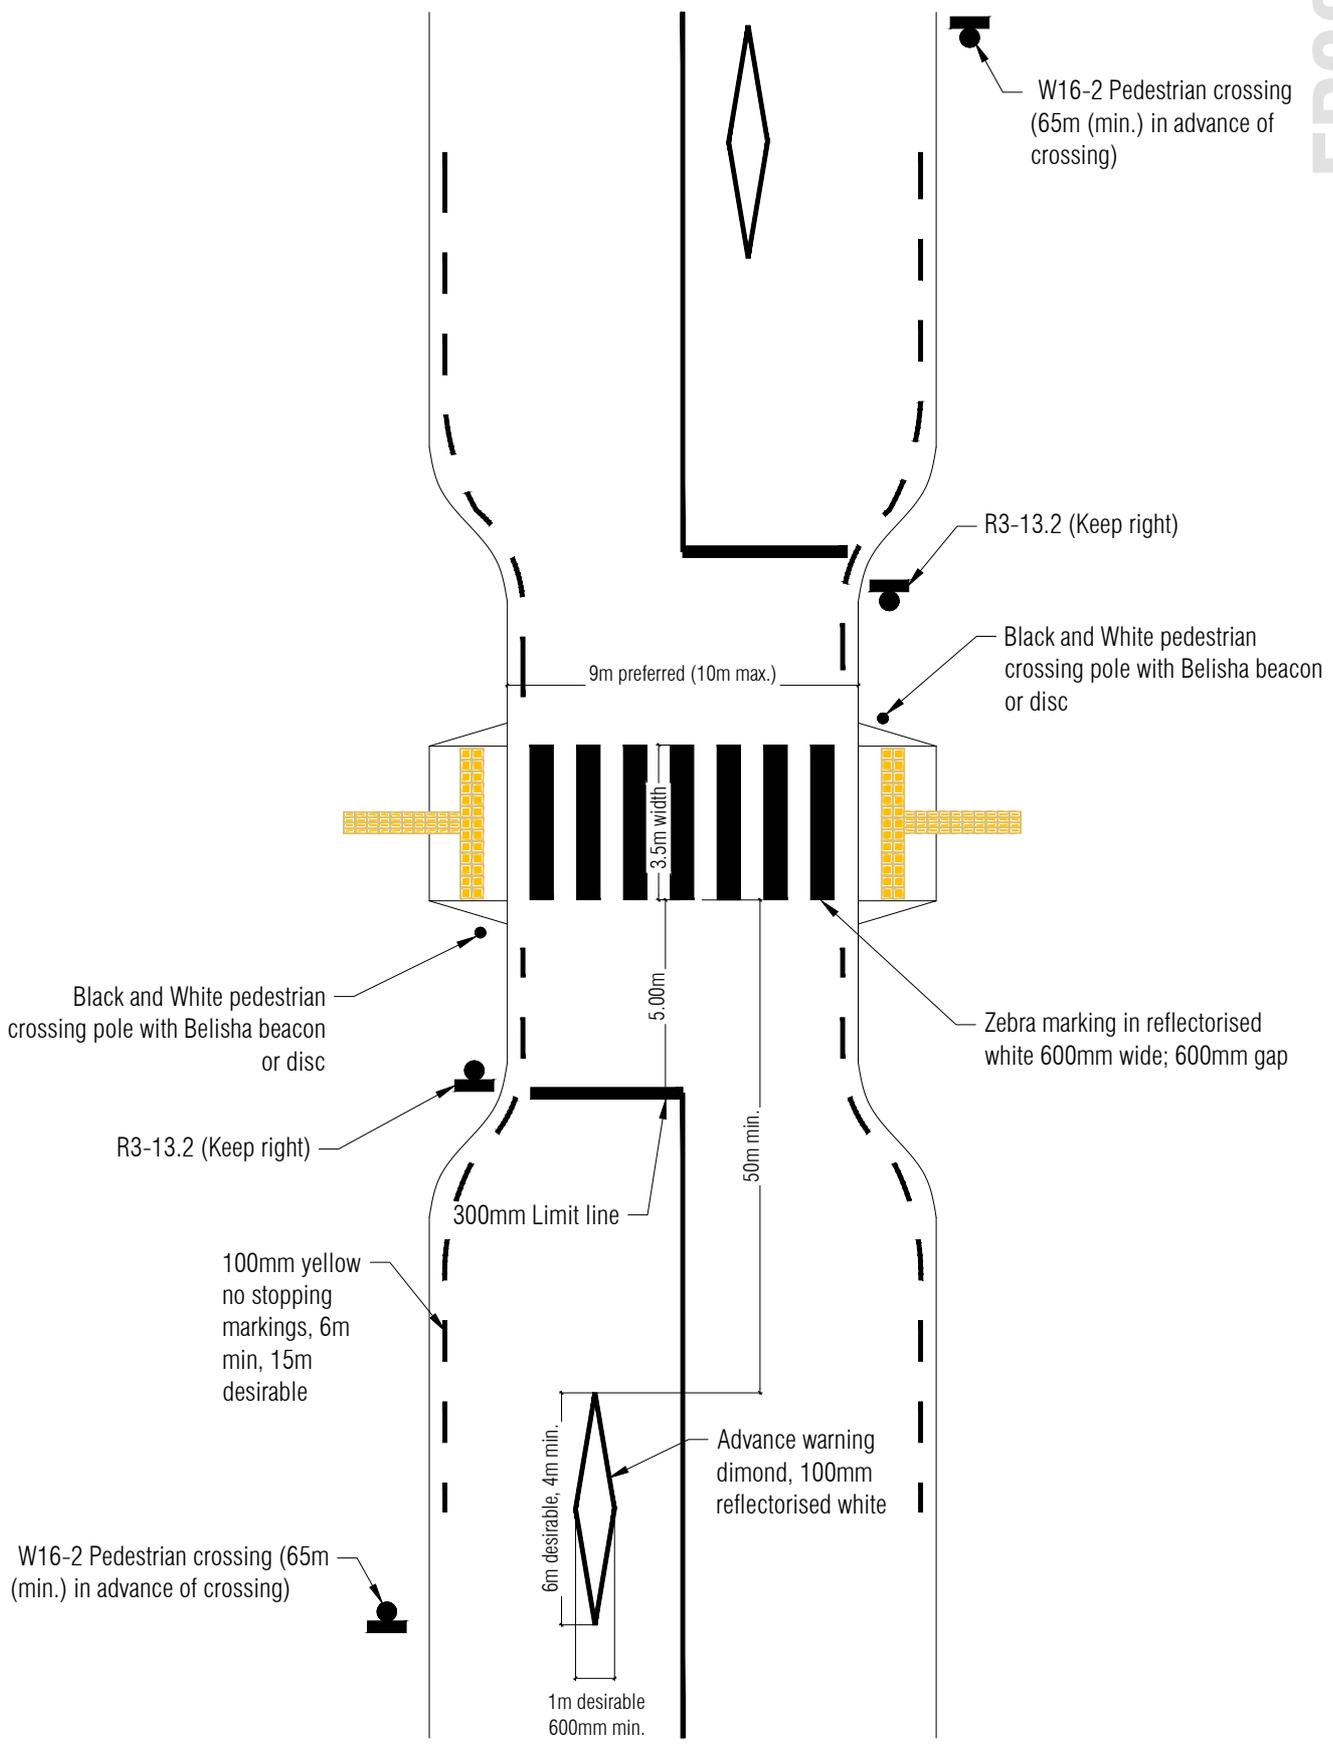


TDM TECHNICAL STANDARDS
Zebra Crossing - Side Island/kerb buildouts


Date:	05/03/2026	
SED No.	Version	
FP0013	A	

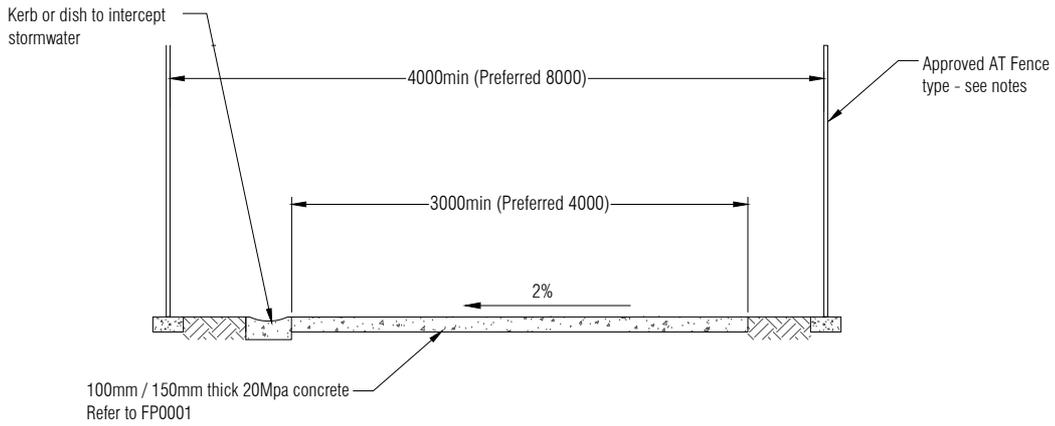

SECTION - CENTRAL 3.0m PATH
SCALE 1 : 50

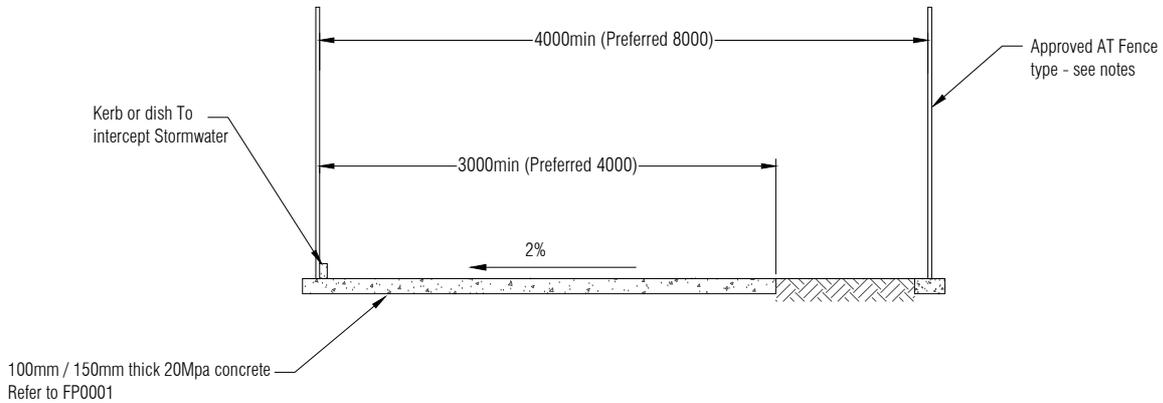

SECTION - 3.0m PATH TO SIDE
SCALE 1 : 50

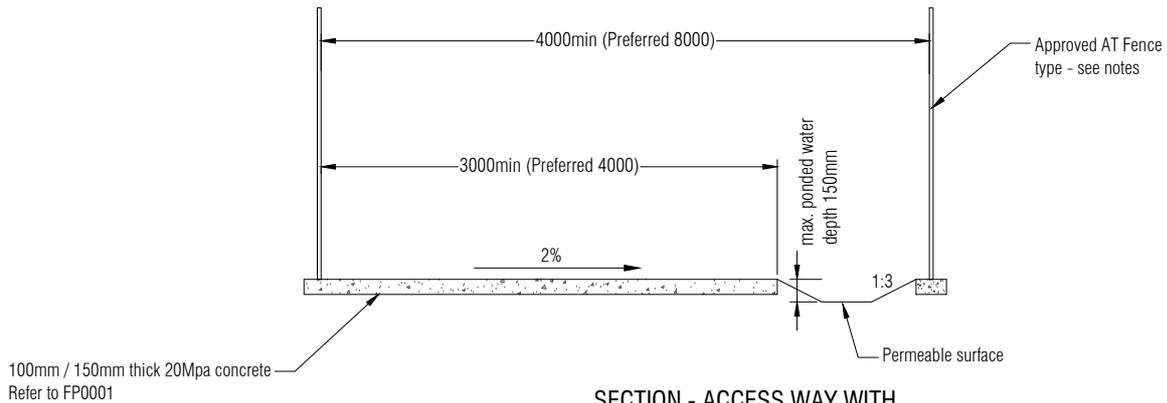

SECTION - ACCESS WAY WITH
SWALE/RAINGARDEN
SCALE 1 : 50

NOTES

1. Fences shall be open boarded 1.2m in height as per the Fence standard details unless agreed by departure from standard.
2. Refer to Auckland Transport EDC Footpath and Public Realm section 3.3 Pedestrian Accessway for further explanation.



TDM TECHNICAL STANDARDS
Pedestrian & cyclist access way alternative sections

Date: 05/03/2026

SED No. Version

FP0014 A