



Walkway

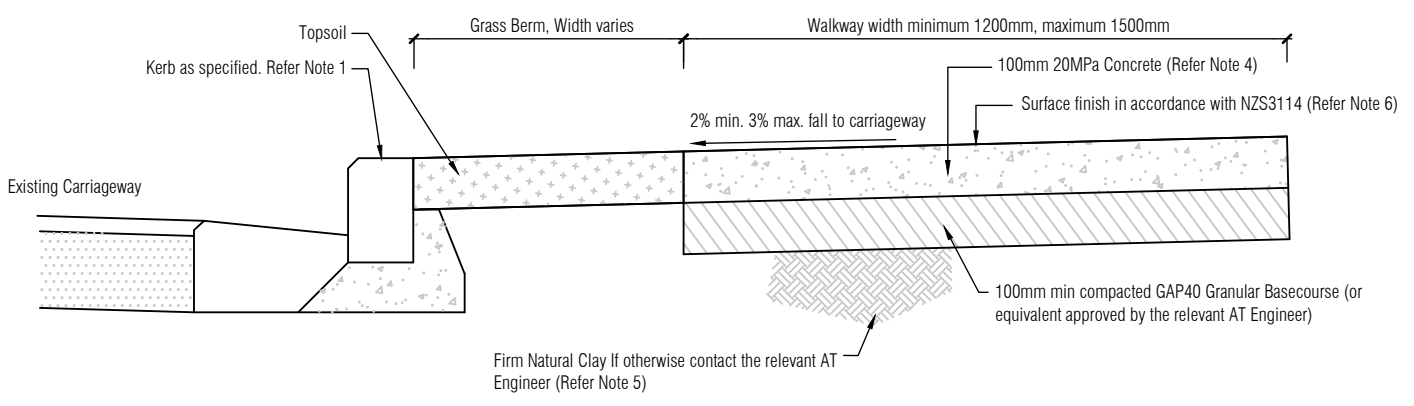

Walkway with Front Berm

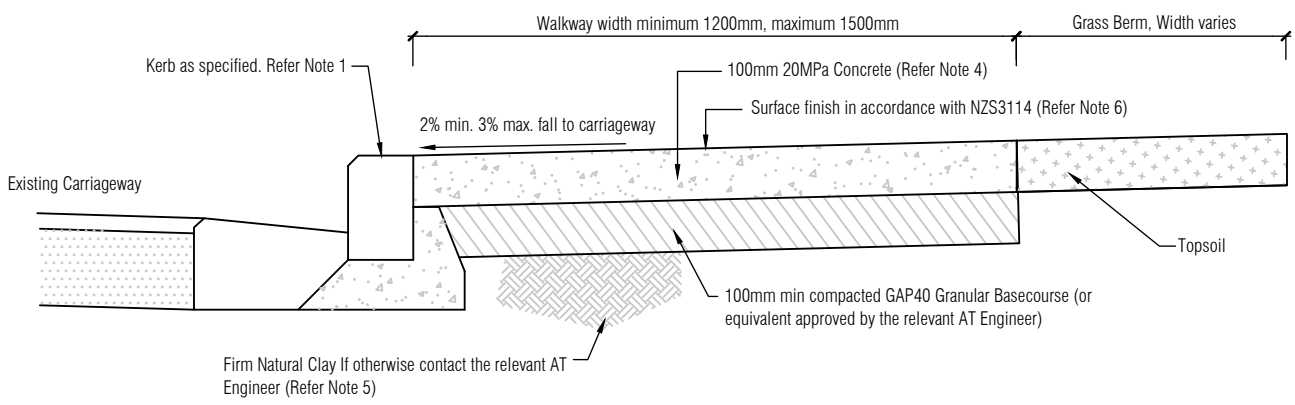

Walkway with Back Berm

NOTES

1. Refer to Auckland Transport Standard Detail Drawings for the following details :-  
Pram Crossings - Plan No. FP0006  
Kerbs and Channels - Refer to Drawing Set KC0000
2. Minimum walkway width is 1200mm. Maximum walkway width is 1500mm
3. All Services Lids must be raised or lowered to be flush with walkway levels, to match footpath finish.
4. All concrete to be 20MPa constructed in accordance with NZS 3109 with broom or exposed aggregate finish and contain upto 4Kg/m<sup>3</sup> black oxide.
5. Basecourse (or bedding) layer depth must be increased for weak subgrade (CBR<3). As directed by the relevant AT engineer.
6. Construct in same material and finish as surrounding footpath or vehicle crossing.



TDM TECHNICAL STANDARDS  
Concrete Walkway

Date:	11/04/2022	
SED No.	VX0401	Version
	B	