


NOTES

1. Fence panels must be hot dip galvanised and powder coated 'Karaka Green' or as approved by the relevant AT Engineer.
2. Fence panels must not have more than 100mm gap from ground level to installed panel.
3. Posts must be 50mmØ hot dip galvanised pipe and powder coated 'Karaka Green' or as approved by the relevant AT Engineer.
4. Posts must be installed vertical.
5. Sharp edges of the panel are to be rounded off before galvanising.
6. Tolerances on overall dimensions of the finished panel to be 25mm and bars to be placed within 2mm of their true location.

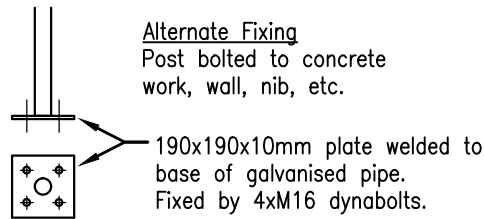

POST DETAIL

REVISION	BY	DATE
Draft - for comment	MD	06/13



TITLE

AUCKLAND TRANSPORT
CODE OF PRACTICE

**TYPICAL WIRE FENCE
DETAIL A**

SCALE:



N.T.S.

DRAWING No.

RR009


VERSION

1.0

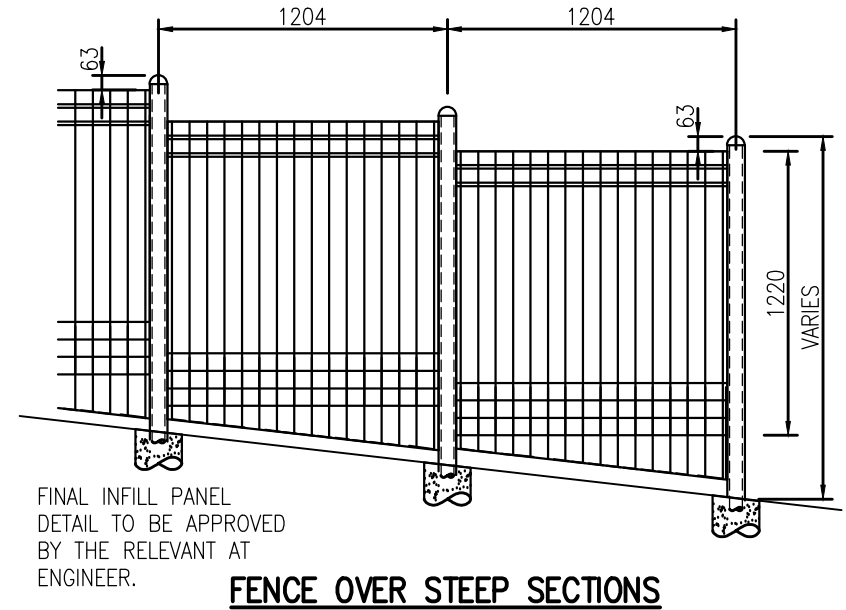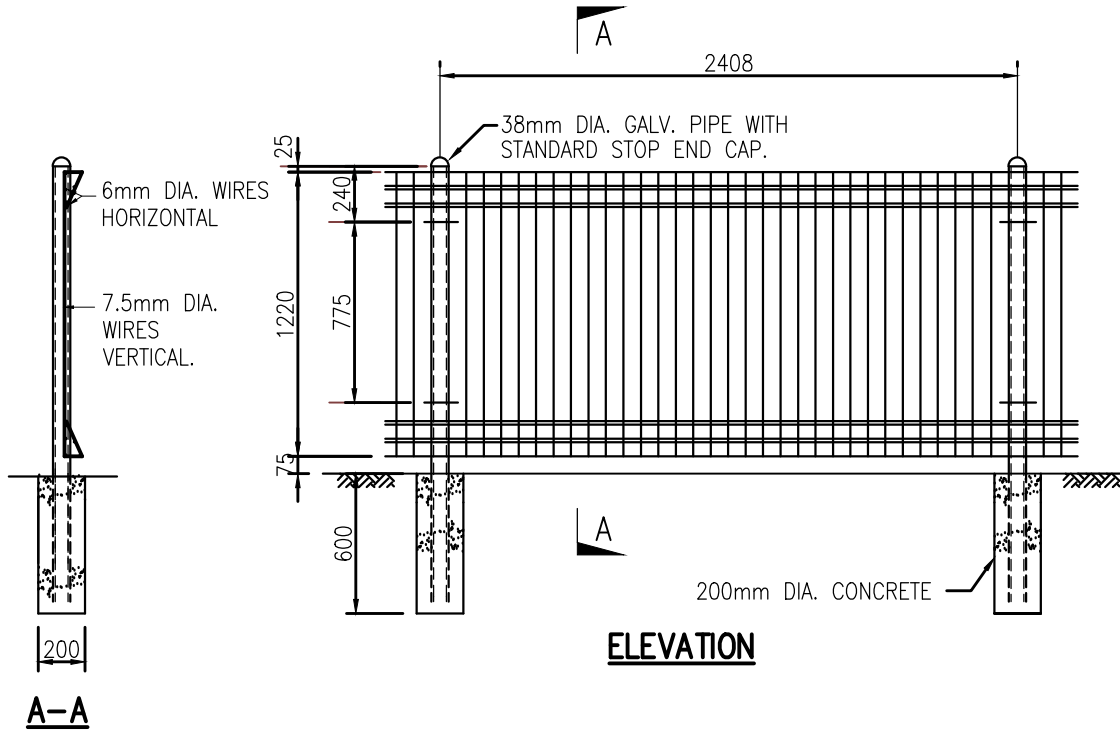

- NOTES**
1. STEEL TO BE HIGH TENSILE WITH ULTIMATE STRENGTH OF 600-800N/mm .
 2. THE RODS ARE TO BE ELECTRICALLY WELDED TO COMPLY WITH NZS 3422.
 3. TOLERANCES ON OVERALL DIMENSIONS OF THE FINISHED PANEL TO BE 25mm AND BARS TO BE PLACED WITHIN 2mm OF THEIR TRUE LOCATION.
 4. FOLDED PANELS TO BE GALVANISED TO SPECIFICATION CES 306:1992.
 5. SHARP EDGES OF THE PANEL ARE TO BE ROUNDED OFF BEFORE GALVANISING.

Alternate Fixing
Post bolted to concrete work,
wall, nib, etc.

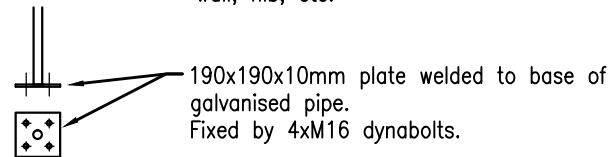

REVISION	BY	DATE
Draft - for comment	MD	06/13



AUCKLAND TRANSPORT CODE OF PRACTICE		SCALE:
TITLE		N.T.S.
TYPICAL WIRE FENCE DETAIL B		DRAWING No. RR010
		VERSION 1.0